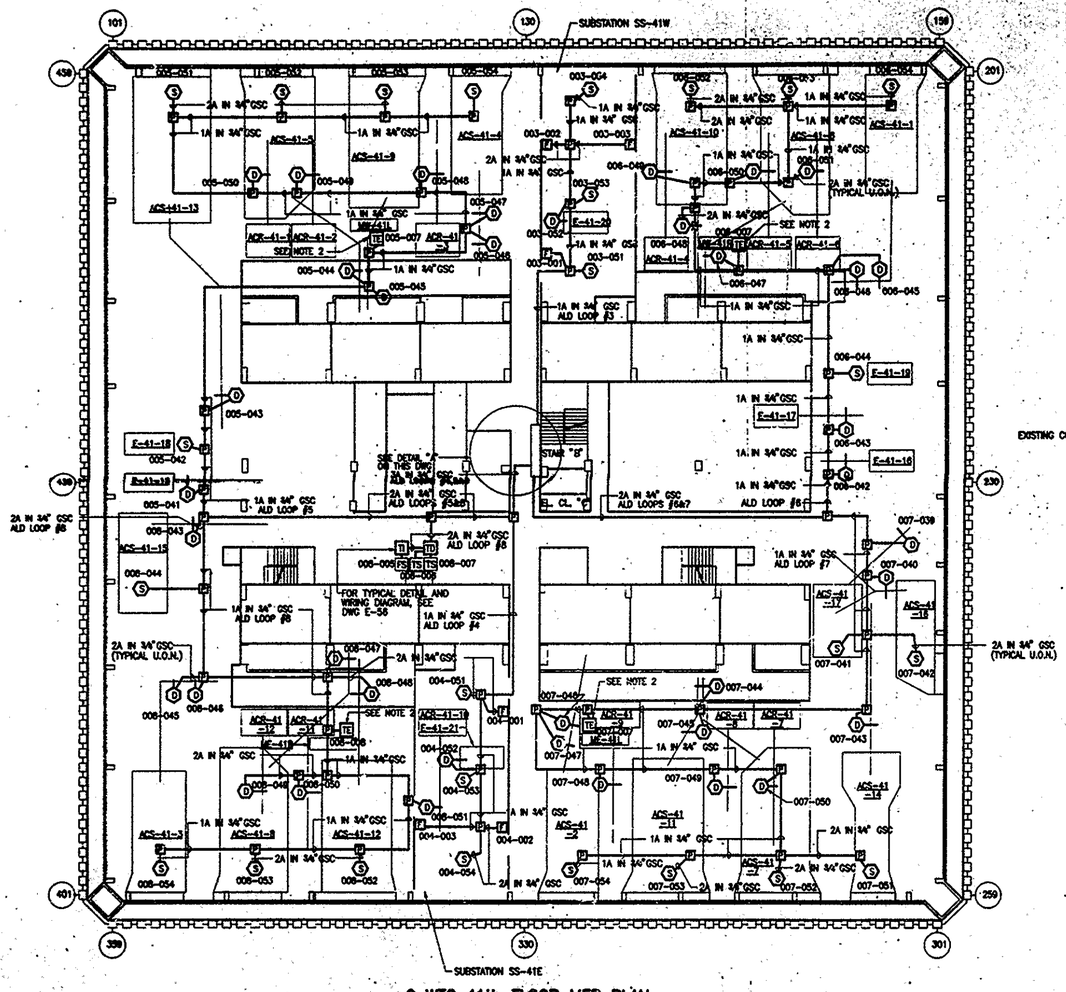

2 WTC 41th FLOOR MER PLAN

0 16 32
SCALE IN FEET

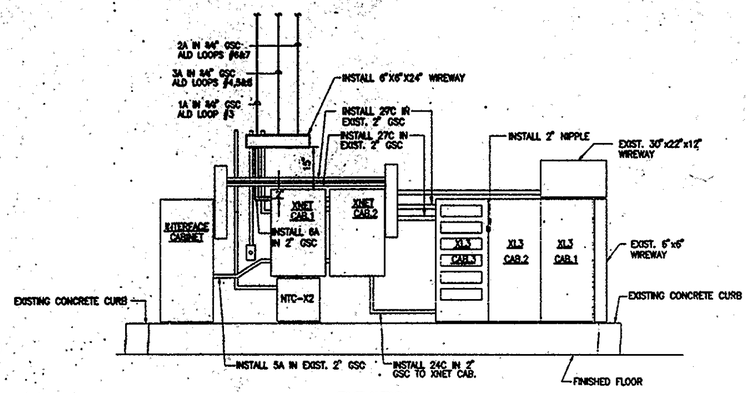

ELEVATION A-A

N.T.S.



DETAIL "A"

0 4 8 12 16
SCALE IN FEET

N

NOTES:

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG E-1.
2. REMOVE TRX AND E.O.L. FROM EXIST. BOX LOCATED ABOVE MCC AND INSTALL TRI-06 AND NEW E.O.L. DISCONNECTION AND RECONNECTION OF PURGE SWITCH CIRCUITRY SHALL BE DONE BY THE CONTRACTOR IN THE PRESENCE OF THE ENGINEER.
3. FOR 41st FLOOR MER RISER DIAGRAM, SEE DWG E-30.
4. FOR 41st FLOOR MER REMOVAL PLAN, SEE DWG E-32.

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-861.062 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 2/1/00 CONTRACT ENGR./ARCH.

DATE 2/1/00 ENGINEERING PROGRAM MGR.



KEY PLAN
41st FLOOR

Sheet 33 of 56

THE PORT AUTHORITY OF NY & NJ

ENGINEERING PROGRAM MANAGER WORLD TRADE

CHIEF ELECTRICAL ENGINEER

No.	Date	Revision	Approved

Engineering Department
Design Division
The World Trade Center

Title
FIRE ALARM SYSTEM
PHASE III
XL3 CONVERSION

ELECTRICAL

2 WTC
41st FLOOR MER PLAN
AND 42nd FLOOR PART PLAN

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

Designed by	Drawn by	Checked by
ROYZMAN FELDSTEIN	ROYZMAN	A.S.

Date 5-20-99 Scale AS NOTED

Contract Number WTC-861.062 Drawing Number E-31